



Bathing Water Analysis at Dún Laoghaire Baths

Between 09/06/2024 And 09/09/2024

E. Coli (cfu/100ml)

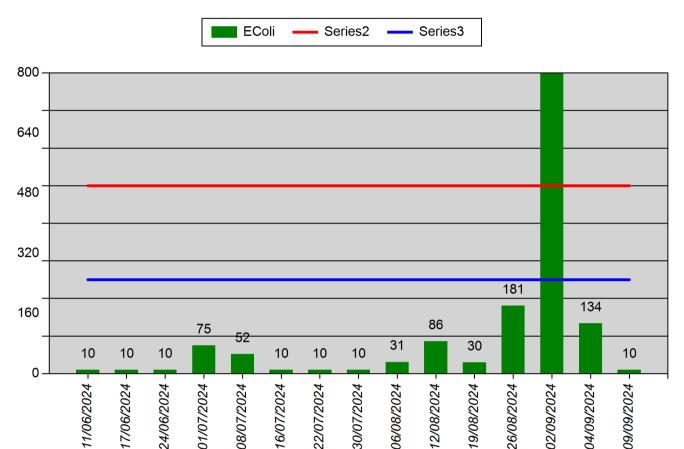

Enterococci (cfu/100ml)

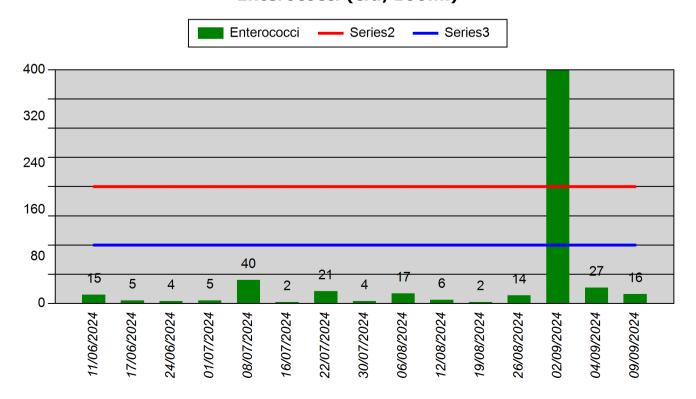



Bathing Water Analysis at Dún Laoghaire Baths

Between 09/06/2024 And 09/09/2024

WHAT DO THESE RESULTS MEAN?

Bacteria Name	E. Coli	Enterococci
Amount Sampled	cfu/100ml	cfu/100ml
Excellent Quality	250(*)	100(*)
Good Quality	500(*)	200(*)
Test Date		
11/06/2024	10	15
17/06/2024	10	5
24/06/2024	10	4
01/07/2024	75	5
08/07/2024	52	40
16/07/2024	10	2
22/07/2024	10	21
30/07/2024	10	4
06/08/2024	31	17
12/08/2024	86	6
19/08/2024	30	2
26/08/2024	181	14
02/09/2024	24196	2000
04/09/2024	134	27
09/09/2024	10	16

^(*) Based upon a 95-percentile evaluation

Blue Flag and Bathing Water Quality

The bathing water is continuously monitored for the different types of bacteria shown in the tables above and is tested at least every 15 days. In this table you can see when the water has been analysed and how many bacteria were found.

A small number of bacteria will tell you that the water is very clean - a high number of bacteria will tell you that the water may be polluted.

E. Coli Escherichia coli is a faecal coliform and indicator organism because it occurs in the intestinal flora of both animals and humans. Contamination allows the organism to spread to water environments

where its presence indicates faecal contamination.

Enterococci are widely distributed in the environment and are normal commensals of the intestinal Enterococci