


© COPYRIGHT OF THIS DRAWING IS RESERVED BY DBFL CONSULTING ENGINEERS. NO PART SHALL BE REPRODUCED OR TRANSMITTED WITHOUT THEIR WRITTEN PERMISSION.

NO CHANGES OF WHATSOEVER NATURE ARE TO BE MADE TO ANY DETAILS SET OUT OR CONTAINED IN ANY DBFL SPECIFICATIONS OR DRAWINGS UNLESS THE EXPRESS CONSENT HAS BEEN OBTAINED IN ADVANCE, IN WRITING, FROM DBFL.

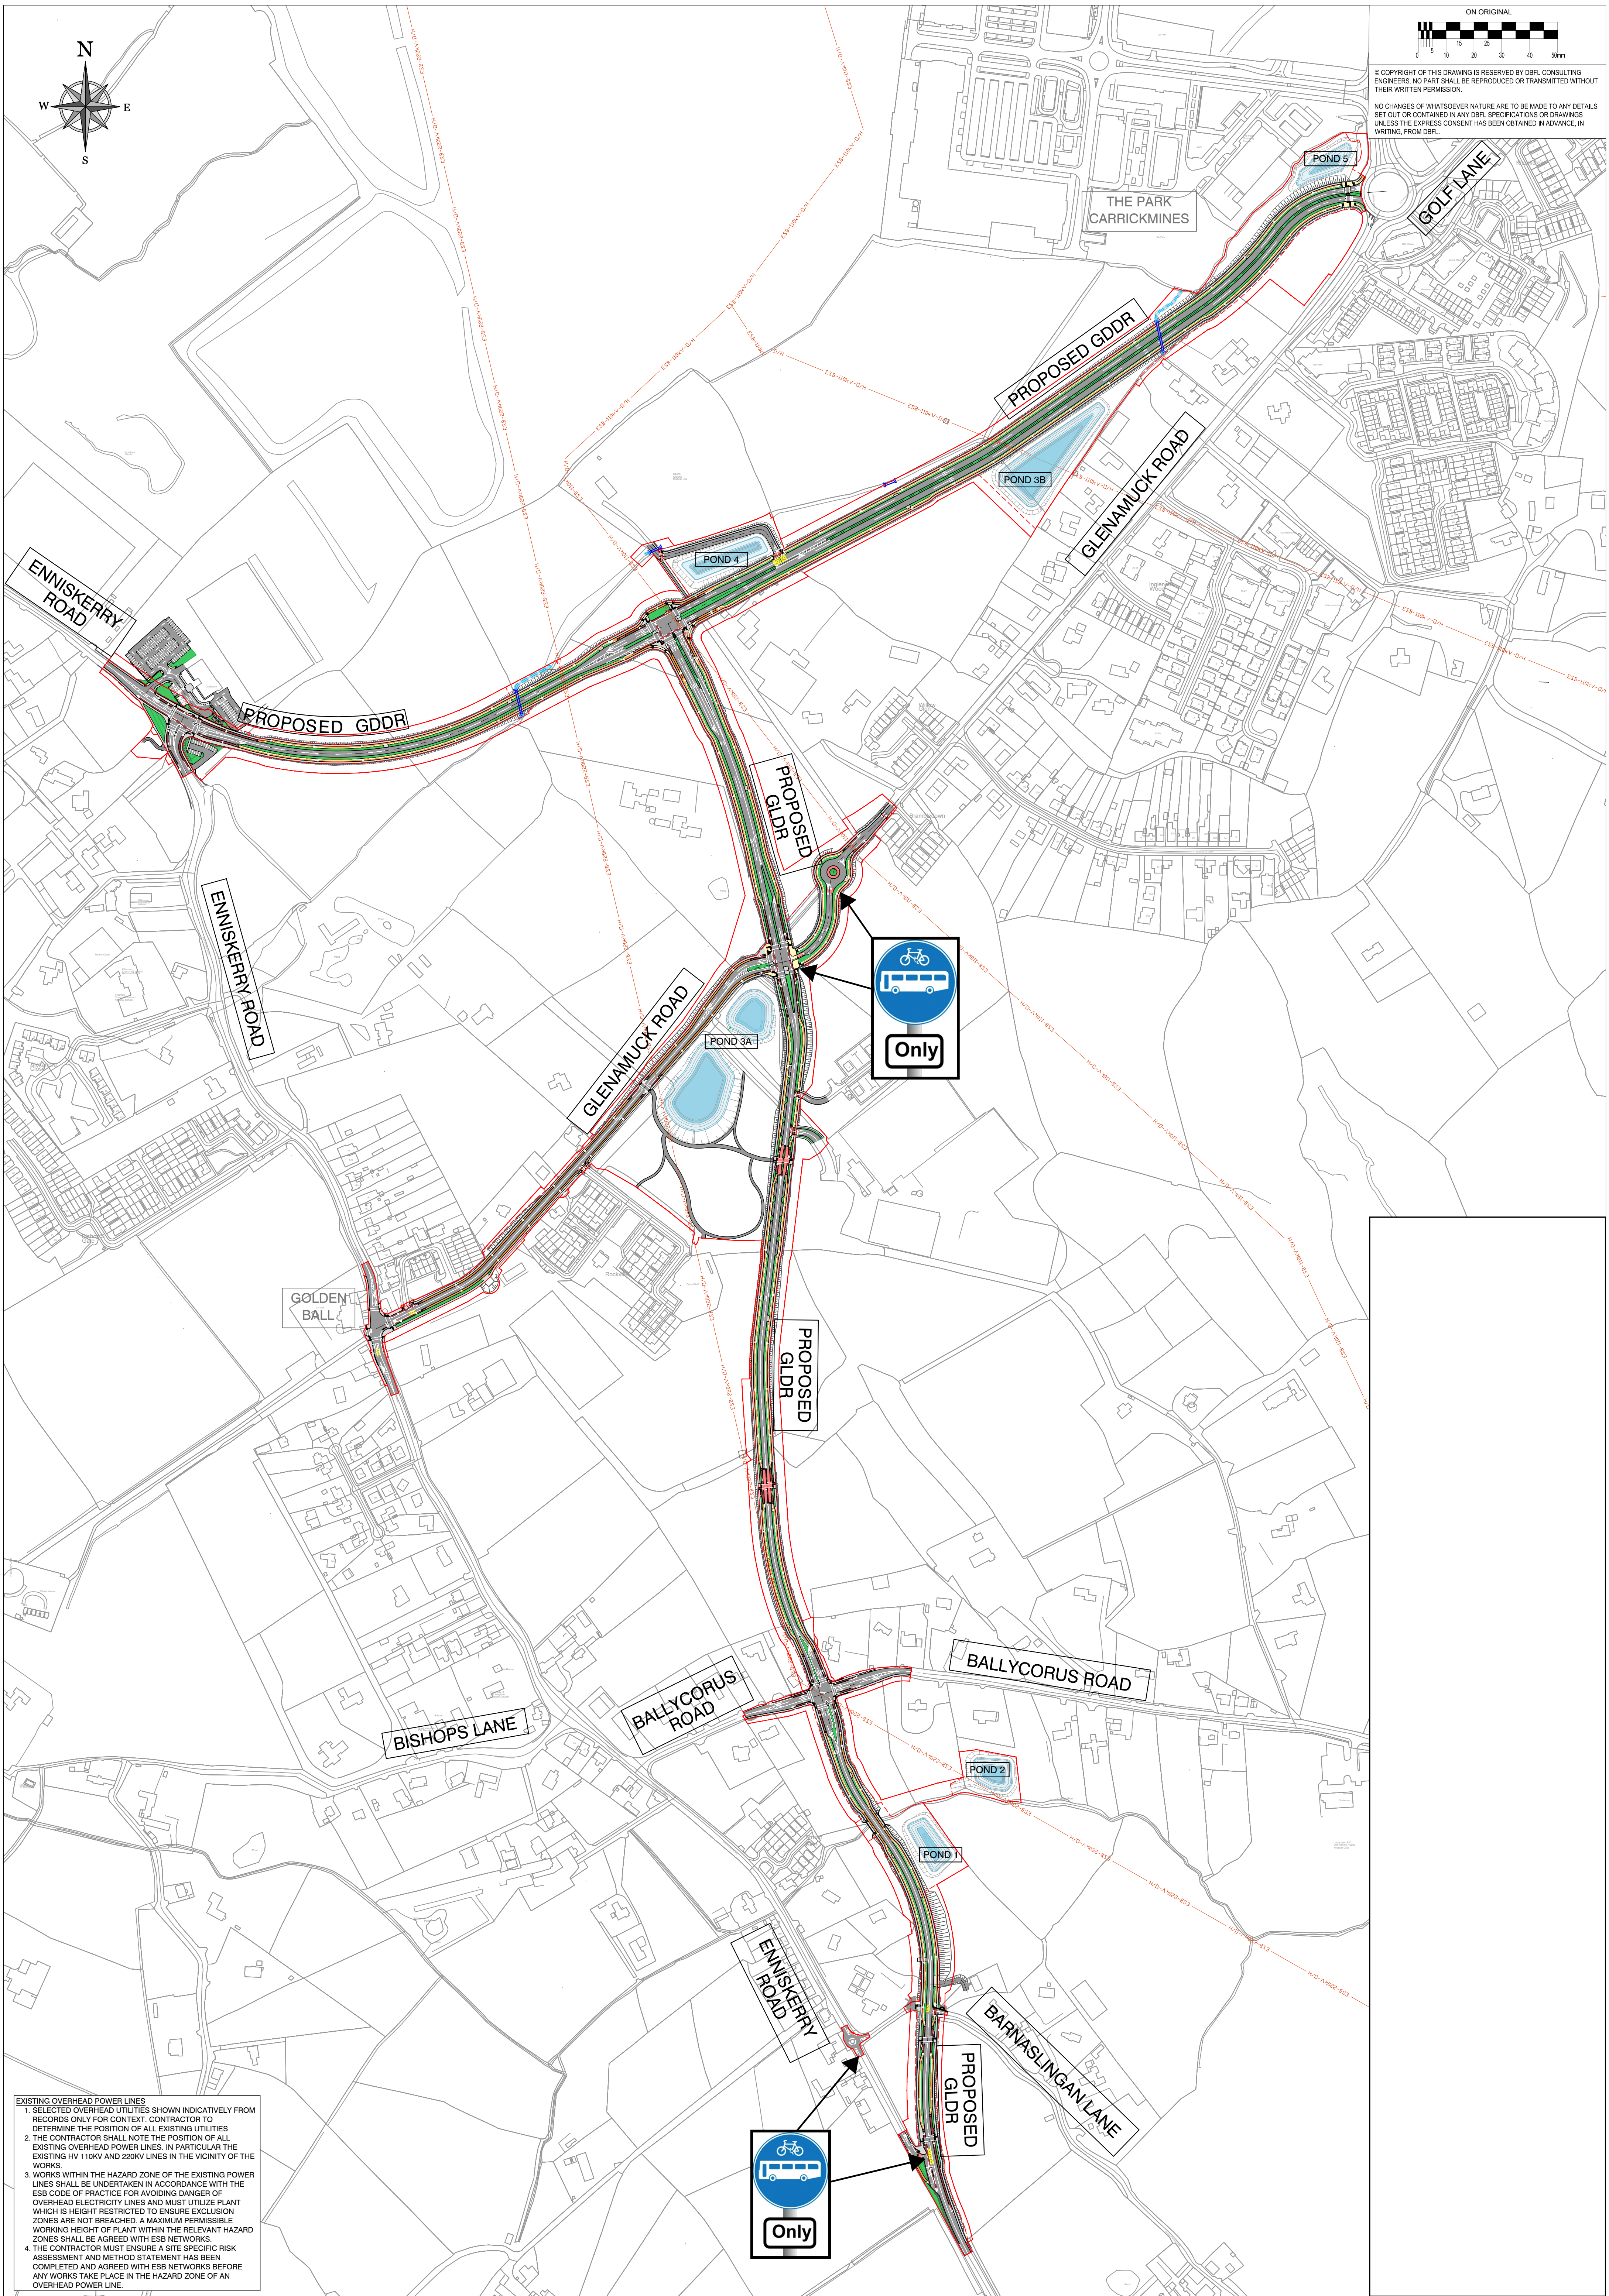

- EXISTING OVERHEAD POWER LINES**
1. SELECTED OVERHEAD UTILITIES SHOWN INDICATIVELY FROM RECORDS ONLY FOR CONTEXT. CONTRACTOR TO VERIFY THE LOCATION AND DEPTH OF ALL EXISTING UTILITIES.
2. THE CONTRACTOR SHALL NOTE THE POSITION OF ALL EXISTING OVERHEAD POWER LINES. IN PARTICULAR THE EXISTING HV 110KV AND 220KV LINES IN THE VICINITY OF THE WORKS.
3. WORKS WITHIN THE HAZARD ZONE OF THE EXISTING POWER LINES SHALL BE UNDERTAKEN IN ACCORDANCE WITH THE ESB CODE OF PRACTICE FOR AVOIDING DANGER OF OVERHEAD ELECTRIFICATION. WORKS WITHIN THE HAZARD ZONE WHICH IS HEIGHT RESTRICTED TO ENSURE EXCLUSION WORKS ARE NOT BREACHED: A MAXIMUM PERMISSIBLE WORKING HEIGHT OF PLANT WITHIN THE RELEVANT HAZARD ZONE SHALL BE AGREED WITH ESB NETWORKS BEFORE WORKS TAKE PLACE.
4. THE CONTRACTOR MUST ENSURE A SITE SPECIFIC RISK ASSESSMENT AND METHOD STATEMENT HAS BEEN COMPLETED AND AGREED WITH ESB NETWORKS BEFORE WORKS TAKE PLACE IN THE HAZARD ZONE OF AN OVERHEAD POWER LINE.